


*Signature Series*

# AURA

## ELECTRIC HEATED SYSTEM


### TOP VIEW

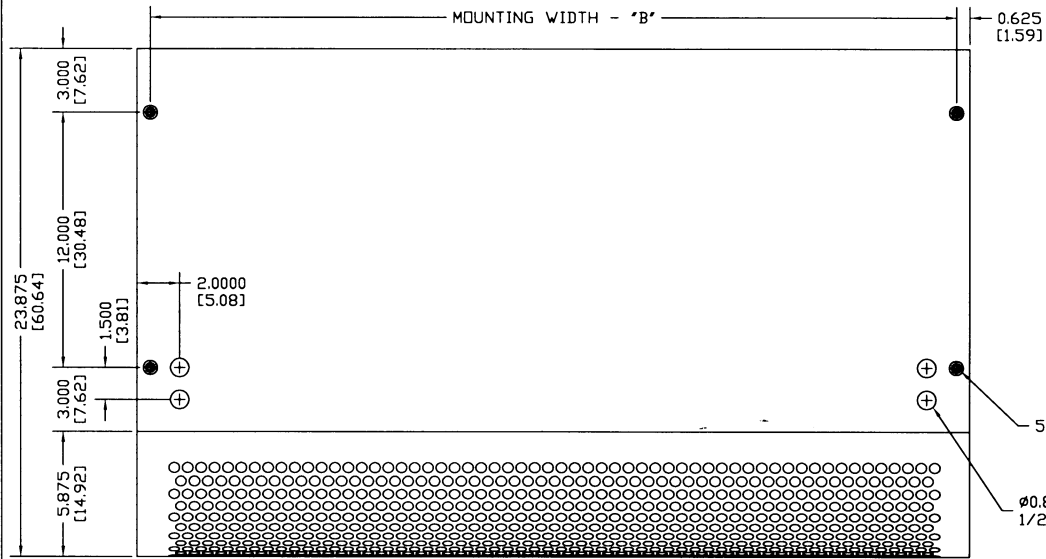

### NOTES:


- ⚠ AIR CURTAIN MUST BE INSTALLED SO AIR STREAM IS NOT OBSTRUCTED WHEN DEFLECTED 20° TO EITHER SIDE OF C.
- ⚠ ELECTRICAL CONNECTIONS TO BE FLEXIBLE.
- ⚠ FIELD VERIFY DIMENSIONS.
- ⚠ ANCHORS TO SUPPORTING STRUCTURE BY OTHERS.
- ⚠ ADEQUACY OF SUPPORTING STRUCTURE IS TO BE VERIFIED BY A PROFESSIONAL STRUCTURAL ENGINEER.
- ⚠ DIMENSIONS INCHES [CENTIMETERS].

### FRONT VIEW

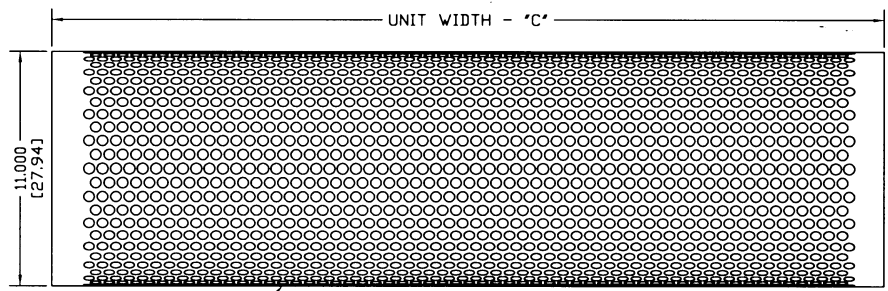


KEEP CLEAR FOR SERVICE

### END VIEW

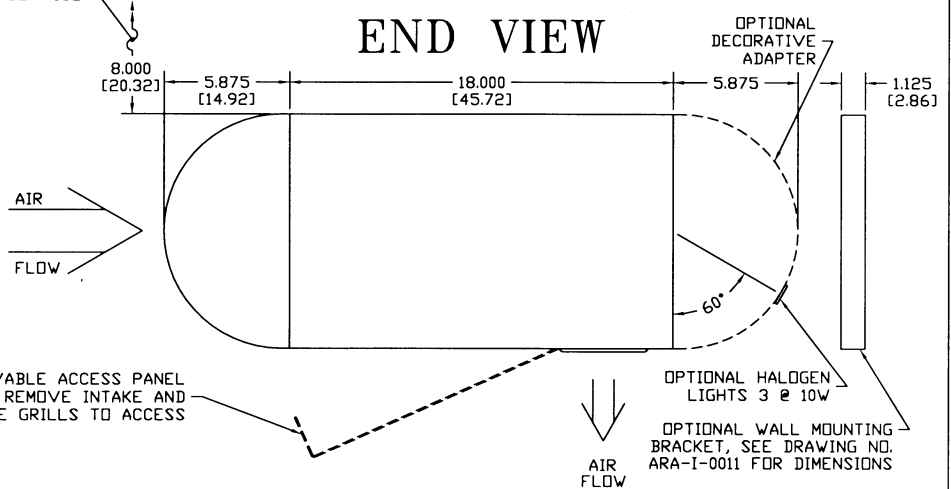

### BOTTOM VIEW

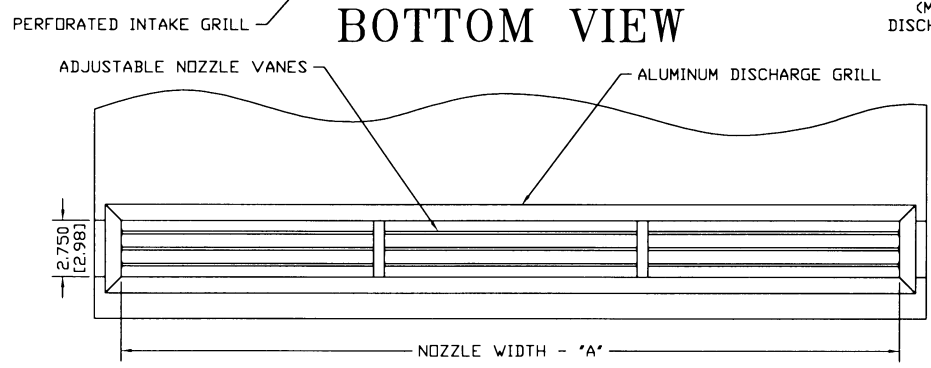

HINGED REMOVABLE ACCESS PANEL (MUST REMOVE INTAKE AND DISCHARGE GRILLS TO ACCESS)

TAG	MODEL	NOZZLE WIDTH "A"	MOUNTING WIDTH "B"	UNIT WIDTH "C"
	ARA1036E	36.500 [92.71]	37.750 [95.89]	39.000 [99.06]
	ARA1042E	42.500 [107.95]	43.750 [111.13]	45.000 [114.30]
	ARA1048E	48.500 [123.19]	49.750 [126.37]	51.000 [129.54]
	ARA1060E	59.500 [151.13]	60.750 [154.31]	62.000 [157.48]

PROJECT		TITLE: <b>BERNER</b> MODEL AURA AIR CURTAIN ELECTRIC HEATED SYSTEM
LOCATION		
ARCHITECT		BERNER INTERNATIONAL CORP. NEW CASTLE, PA.
ENGINEER		
DWG. NO.	ARAL0012	
DATE	14MAR03	
BY	B. Peffer	
REPLACES	21OCT98	
BY	B. Peffer	